


405 S. 8th St, Suite 290  
Boise, Idaho 83702  
p: 208.685.2855  
f: 208.685.2857  
info@think-arch.com

NEW DEVELOPMENT  
**THE 27 ELM**  
A HUNTER RENAISSANCE DEVELOPMENT  
REDMOND OREGON

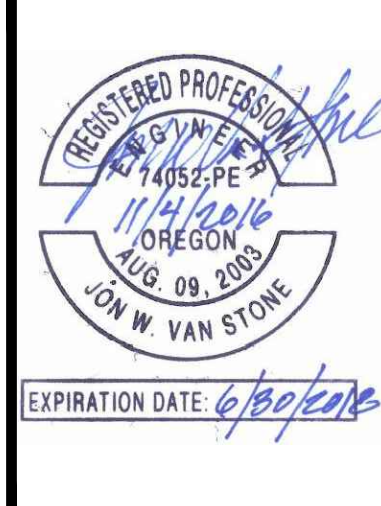


**COVER SHEET**  
Sheet Title  
**AS NOTED**  
Scale  
**1602**  
Project Number  
**NOVEMBER 8, 2016**  
Date  
**16154 E20LDWG**  
File Name  
Revisions  
**E2.0L**

**GENERAL NOTES:**

- 1 CONTRACTOR SHALL COORDINATE ELECTRICAL SYSTEMS INSTALLATION TO AVOID CONFLICTS WITH DUCT WORK/PIPING AND OTHER TRADES
- 2 ALL 120V, 1Ø, BREAKERS SUPPLYING CIRCUITS IN THE FOLLOWING AREAS SHALL BE PROVIDED WITH ARC-FAULT PROTECTION: FAMILY ROOMS, DINING ROOMS, LIVING ROOMS, PARLORS, LIBRARIES, DEN'S, BEDROOMS, SUNROOMS, RECREATION ROOMS, CLOSETS, HALLWAYS OR SIMILAR ROOMS OR AREAS.
- 3 ALL ELECTRICAL PENETRATIONS IN WALLS, CEILINGS, AND FLOORS SHALL MAINTAIN THE FIRE RATING OF THE ASSEMBLY. PROVIDE FIRE CAULK, FIRE RATED ENCLOSURES FOR RECESS FIXTURE AND ETC. AS REQUIRED TO MAINTAIN FIRE RATINGS.
- 4 SEE GENERAL NOTED ON SHEET E2.0P FOR FLUSH REQUIREMENTS.

**KEYED NOTES:**

- 1 ALL RECESSED LIGHTING SHALL BE FURNISHED WITH A FIRE RATED ENCLOSURE OR IC RATED ENCLOSURE TO MAINTAIN FIRE RATINGS AND FIXTURE IC RATINGS.
- 2 FURNISH AND INSTALL UNSWITCHED LEG OF EXTERIOR LIGHTING BRANCH CIRCUIT TO LIGHT FIXTURE ON SECOND FLOOR. SEE SHEET E2.1L FOR ADDITIONAL INFORMATION.
- 3 TO COMBINATION EXHAUST FAN/CEILING LIGHT. BRANCH CIRCUIT SHALL POWER LIGHTING, RECEPTACLE, AND EXHAUST FAN/LIGHT IN BATHROOM.
- 4 SEE SHEET E2.0P FOR SWITCHED RECEPTACLE INFORMATION IN LIVING ROOM.
- 5 TO RECEPTACLE CIRCUIT IN BEDROOM FOR UNSWITCHED LEG.

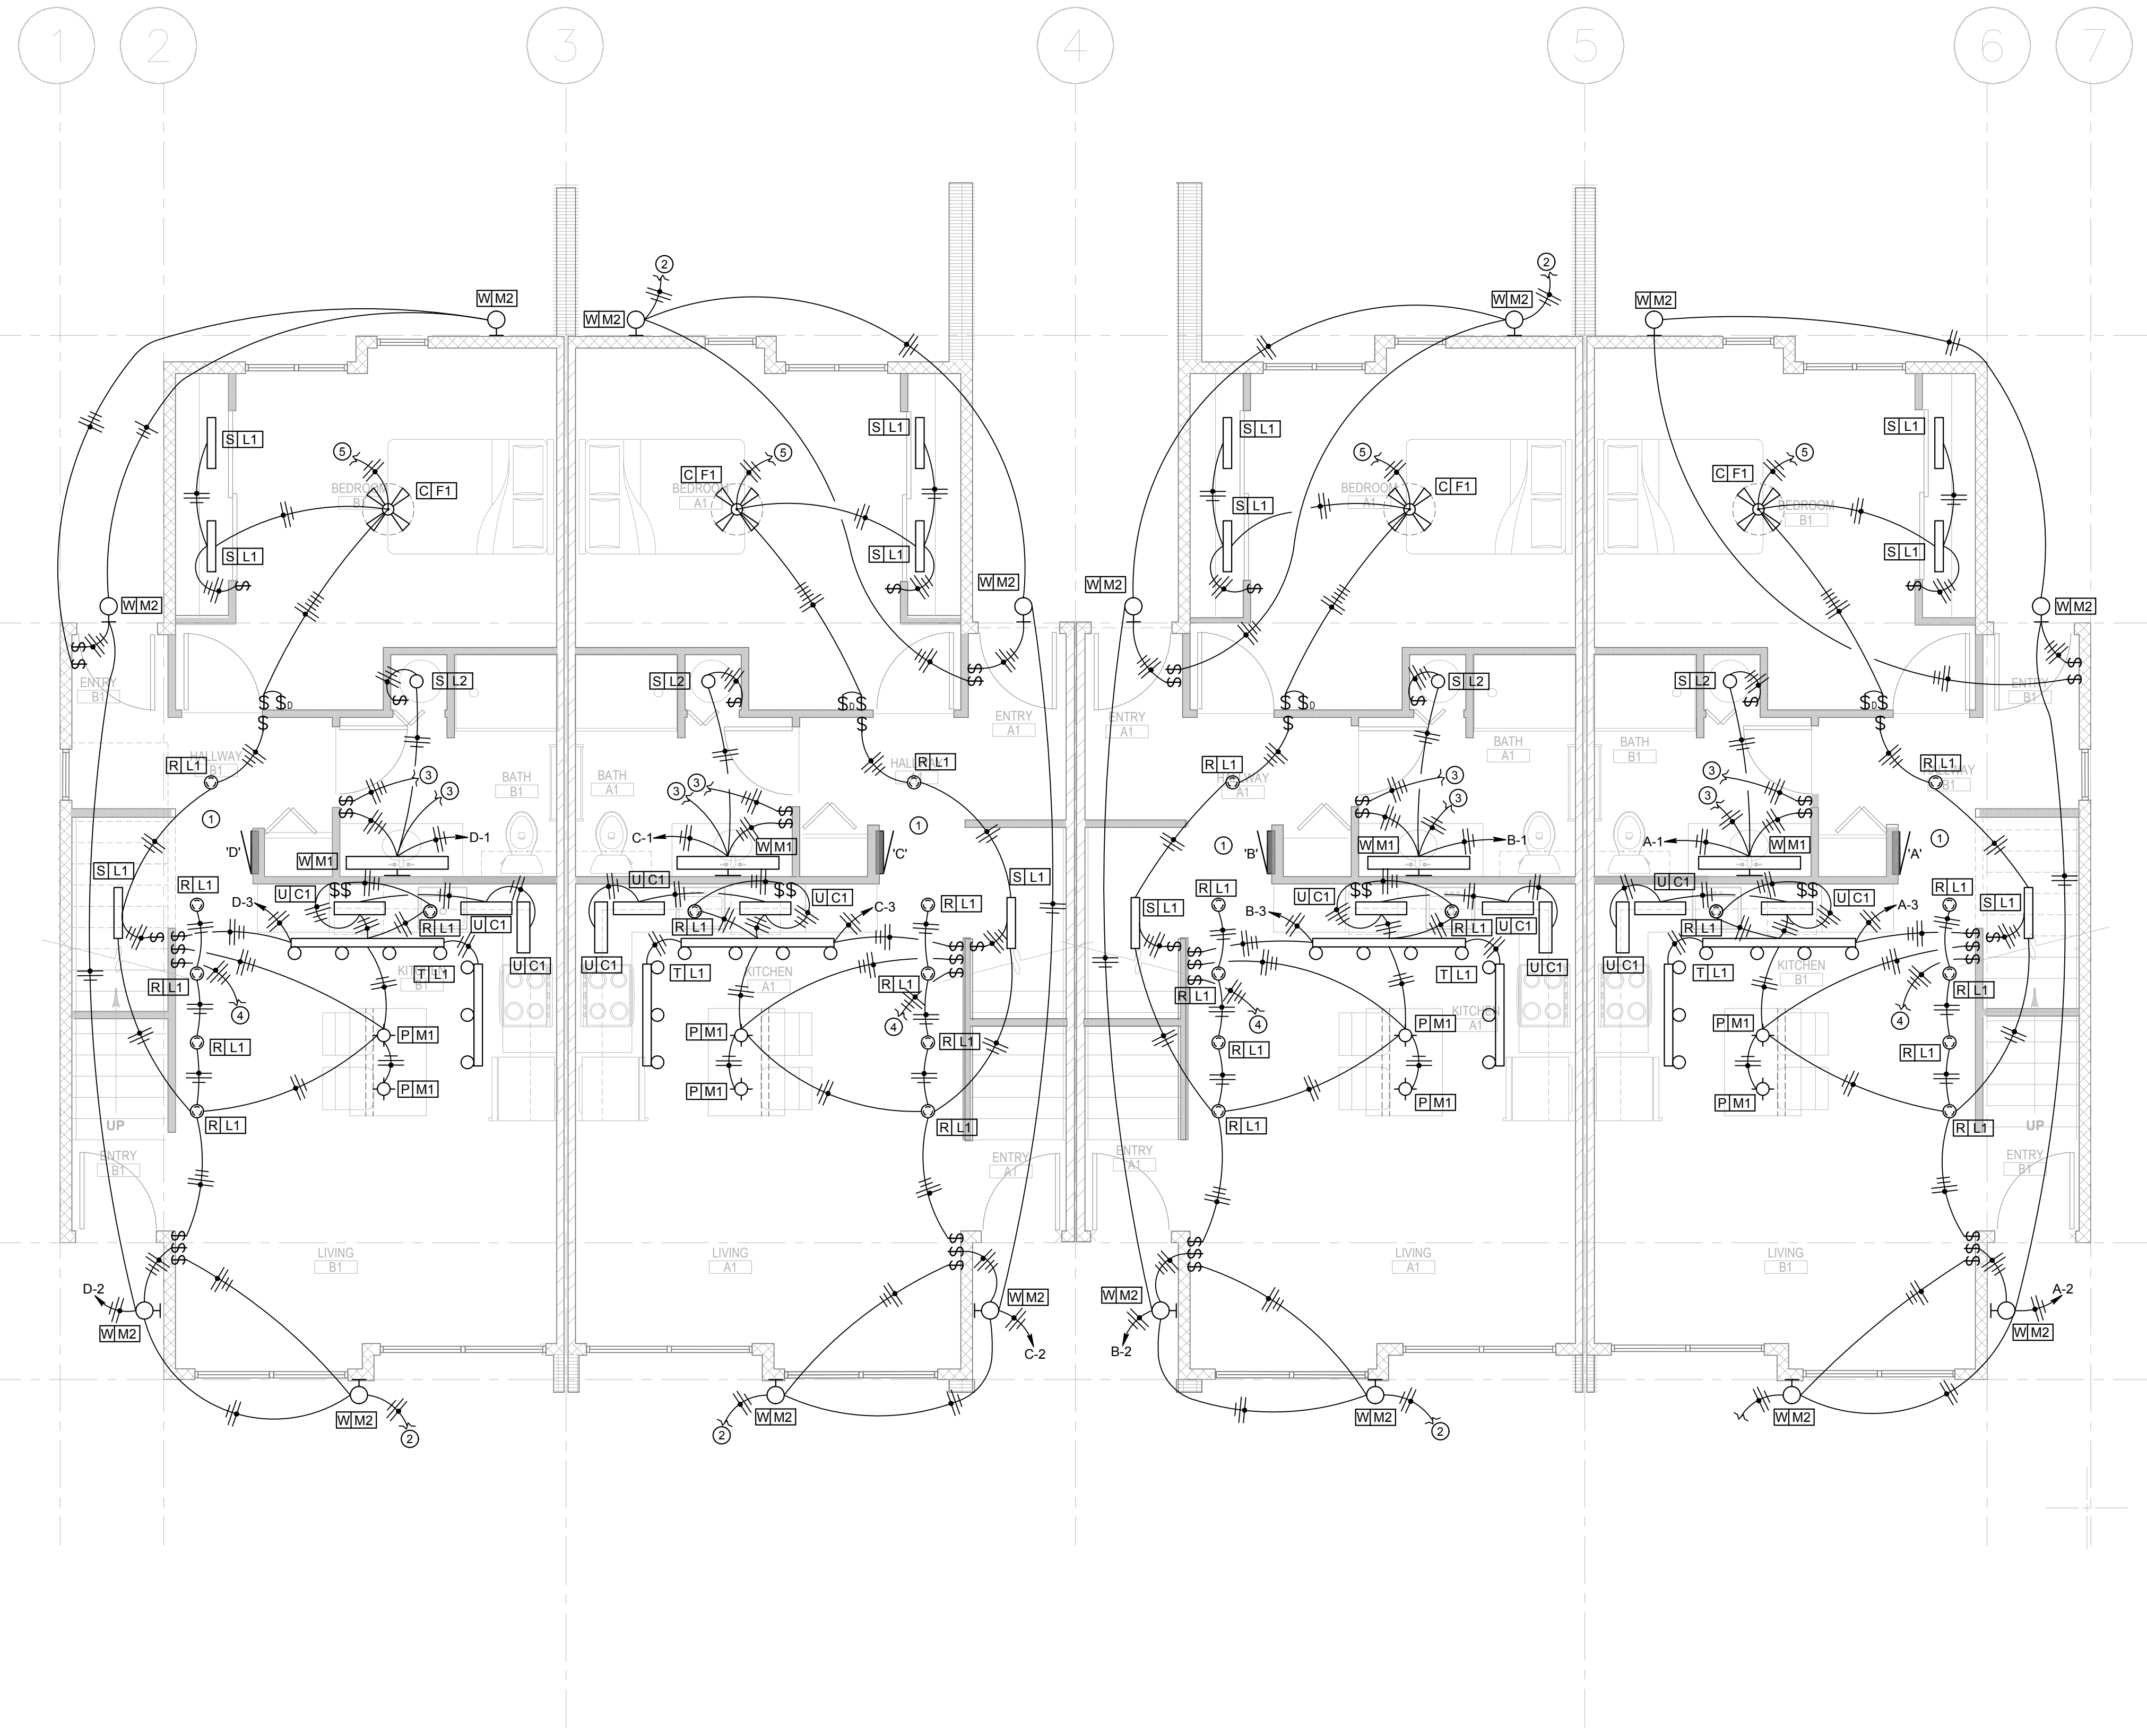

**FIRST FLOOR LIGHTING PLAN**  
SCALE: 1/4" = 1'-0"

**FOR CITY REVIEW**  
**NOT FOR CONSTRUCTION**

**e2co** electricalengineeringcompany  
engineering 4 tomorrow  
world wide web: e2co.com  
800 s. industry way, suite 350  
meridian, idaho 83642  
phone: 208.378.4450  
fax: 208.378.4451  
e2co project #: 16154