


D3 HVAC PLAN - FIRST FLOOR
SCALE: 1/8" = 1'-0"

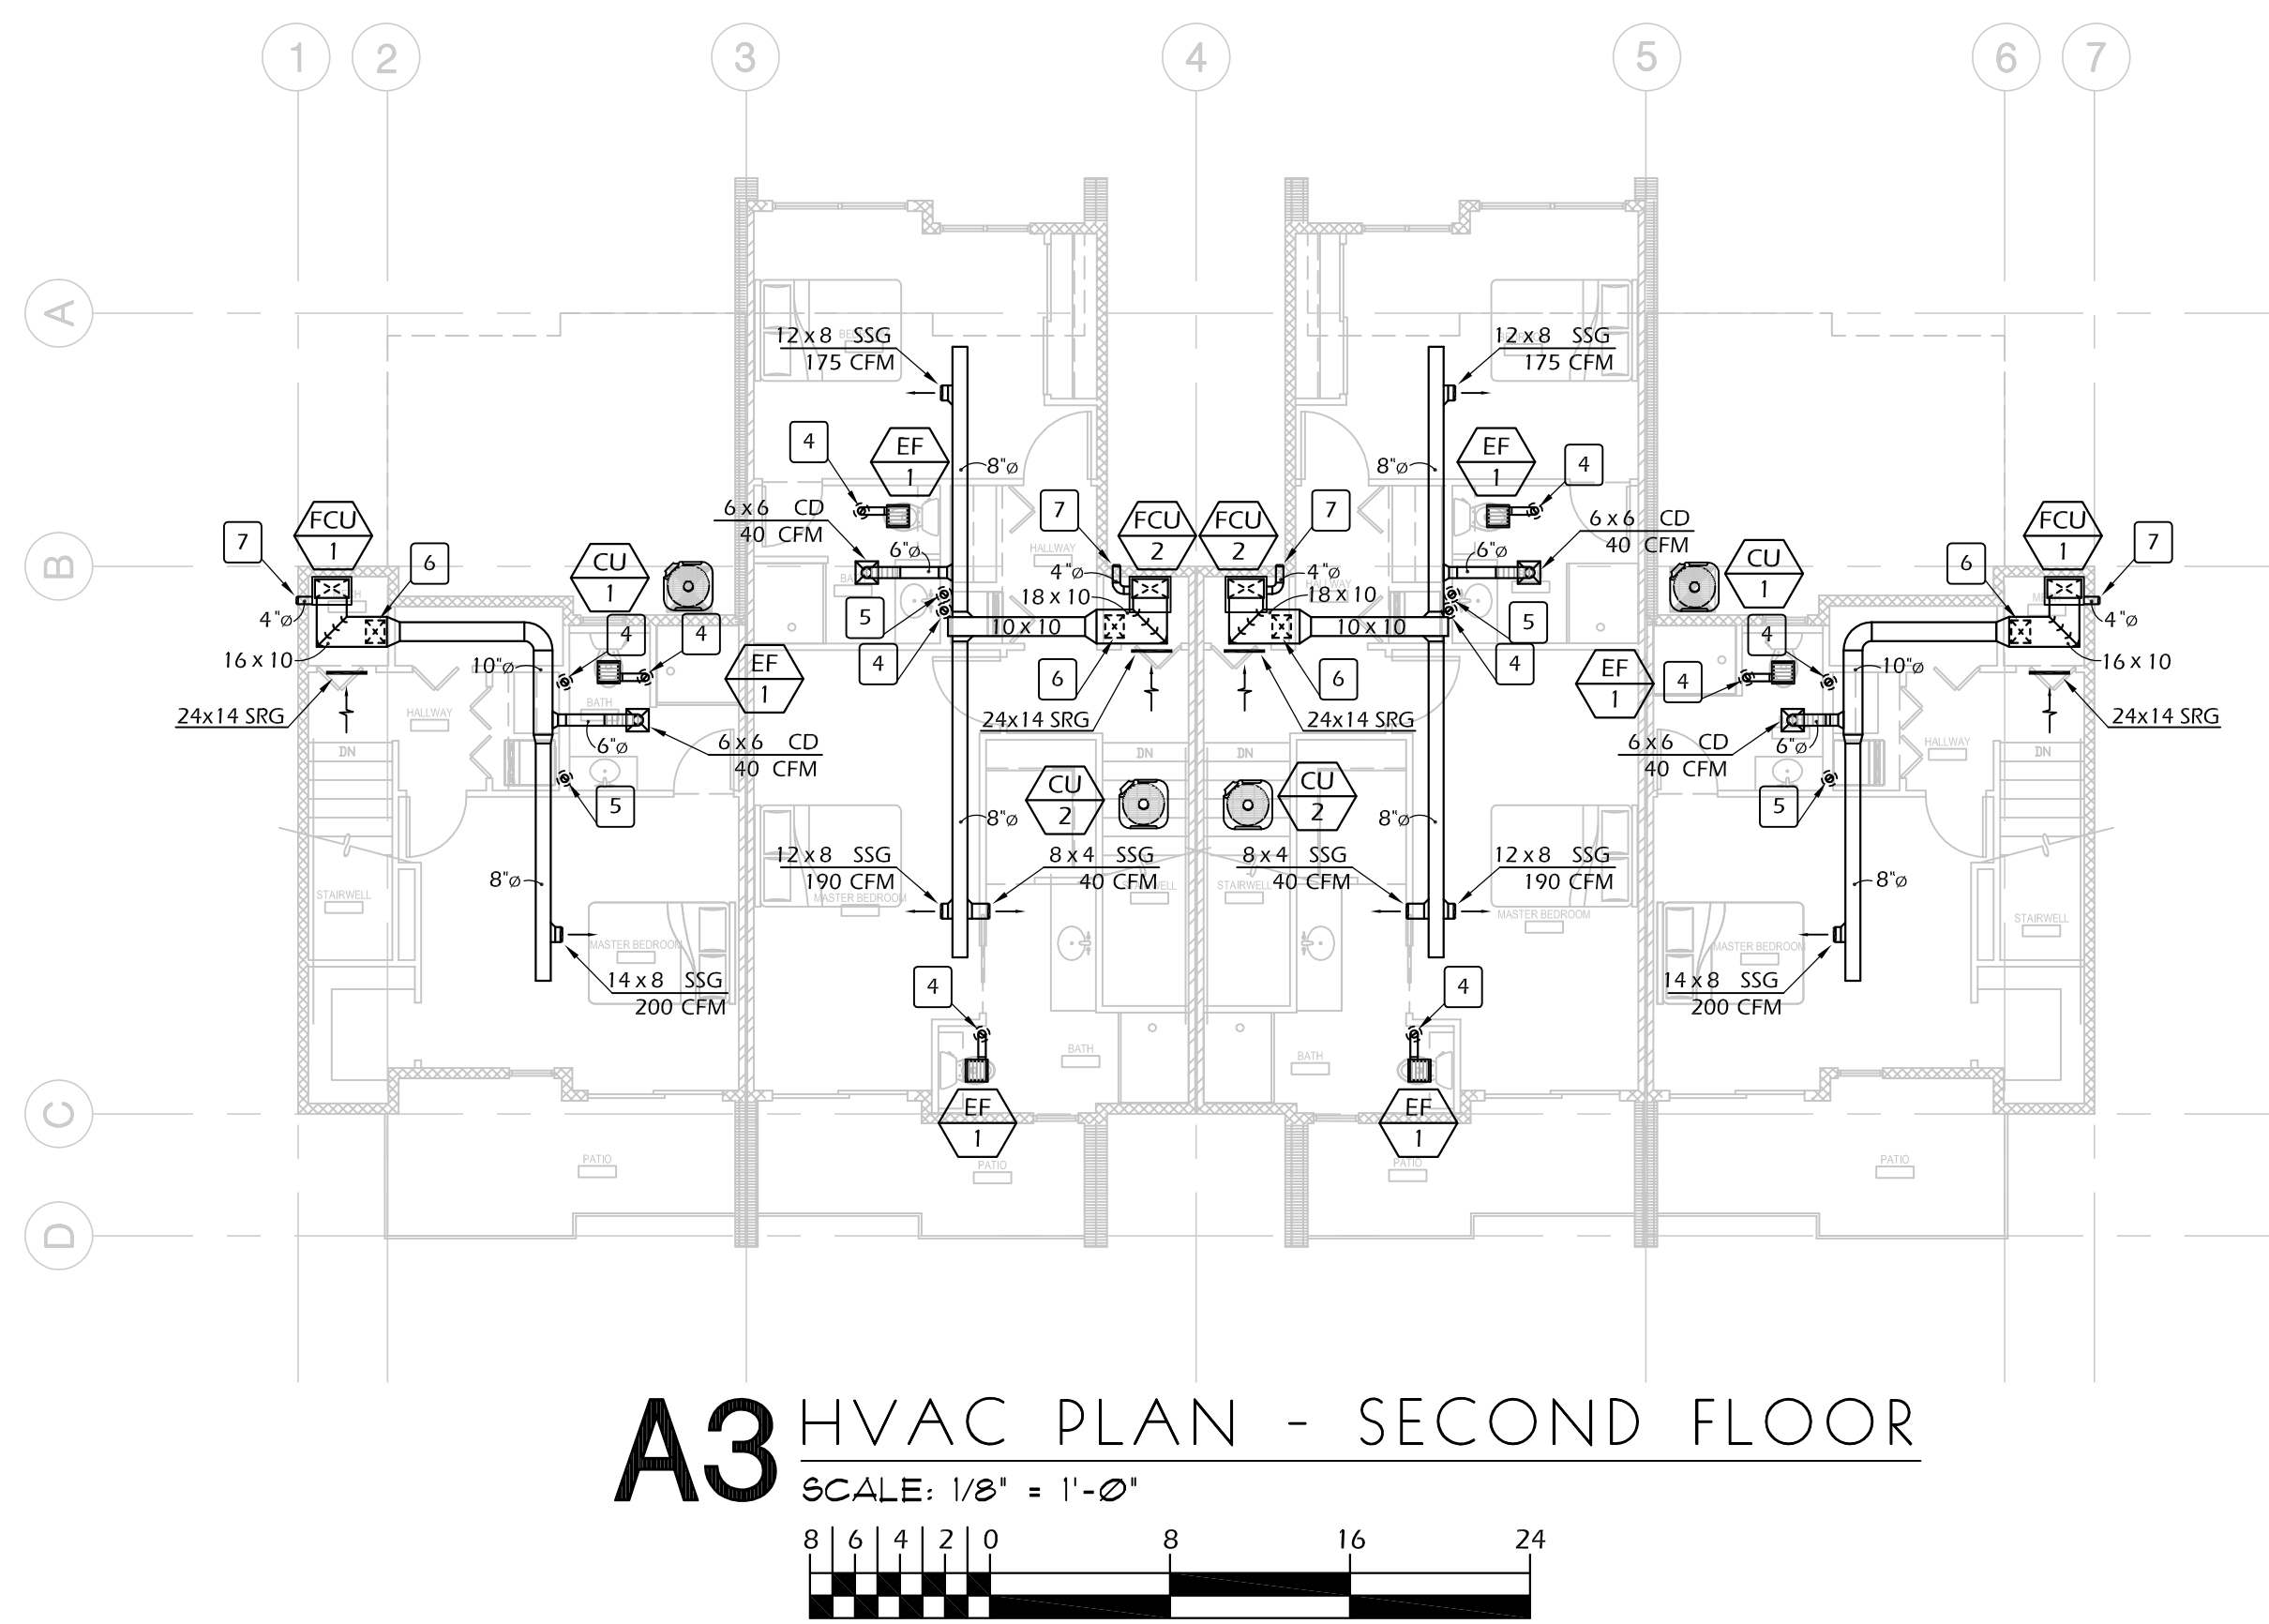

A3 HVAC PLAN - SECOND FLOOR
SCALE: 1/8" = 1'-0"

GENERAL NOTES

- COORDINATE EXACT LOCATION OF DIFFUSERS & GRILLES WITH REFLECTED CEILING & LIGHTING LAYOUTS.
- COORDINATE HVAC EQUIPMENT WITH ALL OTHER TRADES AS REQUIRED.
- ALL DUCT DIMENSIONS SHOWN ARE INTERIOR DIMENSIONS.
- SEAL ALL MECHANICAL PENETRATIONS THROUGH FIRE RATED ASSEMBLIES WITH U.L. APPROVED FIRE RATED SYSTEM.
- ROUND DUCT OR RECTANGULAR DUCT MAY BE SUBSTITUTED FOR DUCT SIZES SHOWN ON PLANS PROVIDED EQUIVALENT AIR PRESSURE DROPS ARE MAINTAINED.
- COORDINATE ALL DUCTWORK PENETRATIONS THROUGH STRUCTURAL BEAMS WITH STRUCTURAL PLANS AND DETAILS PRIOR TO ANY PENETRATIONS BEING MADE.
- KITCHEN HOODS TO BE RE-CIRCULATING WITH CHARCOAL FILTER.
- ALL INDIVIDUAL CONDENSATE FROM FURNACES UNITS TO BE 3/4" AND RAN INTO FLOOR DRAIN.

KEY NOTES

- NOT USED.
- 4" EXHAUST DUCT TO BE RAN UP TO SECOND FLOOR.
- 12x10 SUPPLY DUCT FROM ABOVE.
- 4" EXHAUST DUCT UP TO ROOFCAP.
- 4" DRYER EXHAUST DUCT UP TO ROOF AND TERMINATE WITH ROOF CAP W/ BIRDSCREEN.
- 12x10 SUPPLY DUCT DOWN TO FIRST FLOOR.
- FRESH AIR SUPPLY DUCT. VENT STYLE TO BE COORDINATED WITH ARCHITECT PRIOR TO PURCHASE.



1529 Columbia Park Trail
Suite B312
Richland, WA 99352
p: 208.850.7180

NEW DEVELOPMENT
THE 27 ELM
A HUNTER RENAISSANCE DEVELOPMENT
REDMOND OREGON



HVAC PLAN

Sheet Title

AS NOTED

Scale

1602

Project Number

NOVEMBER 8, 2016

Date

M200 - HVAC PLANDWG

File Name

Revisions



M2.00